


FIRELINE CONNECTION ABOVE GROUND (3"–10")

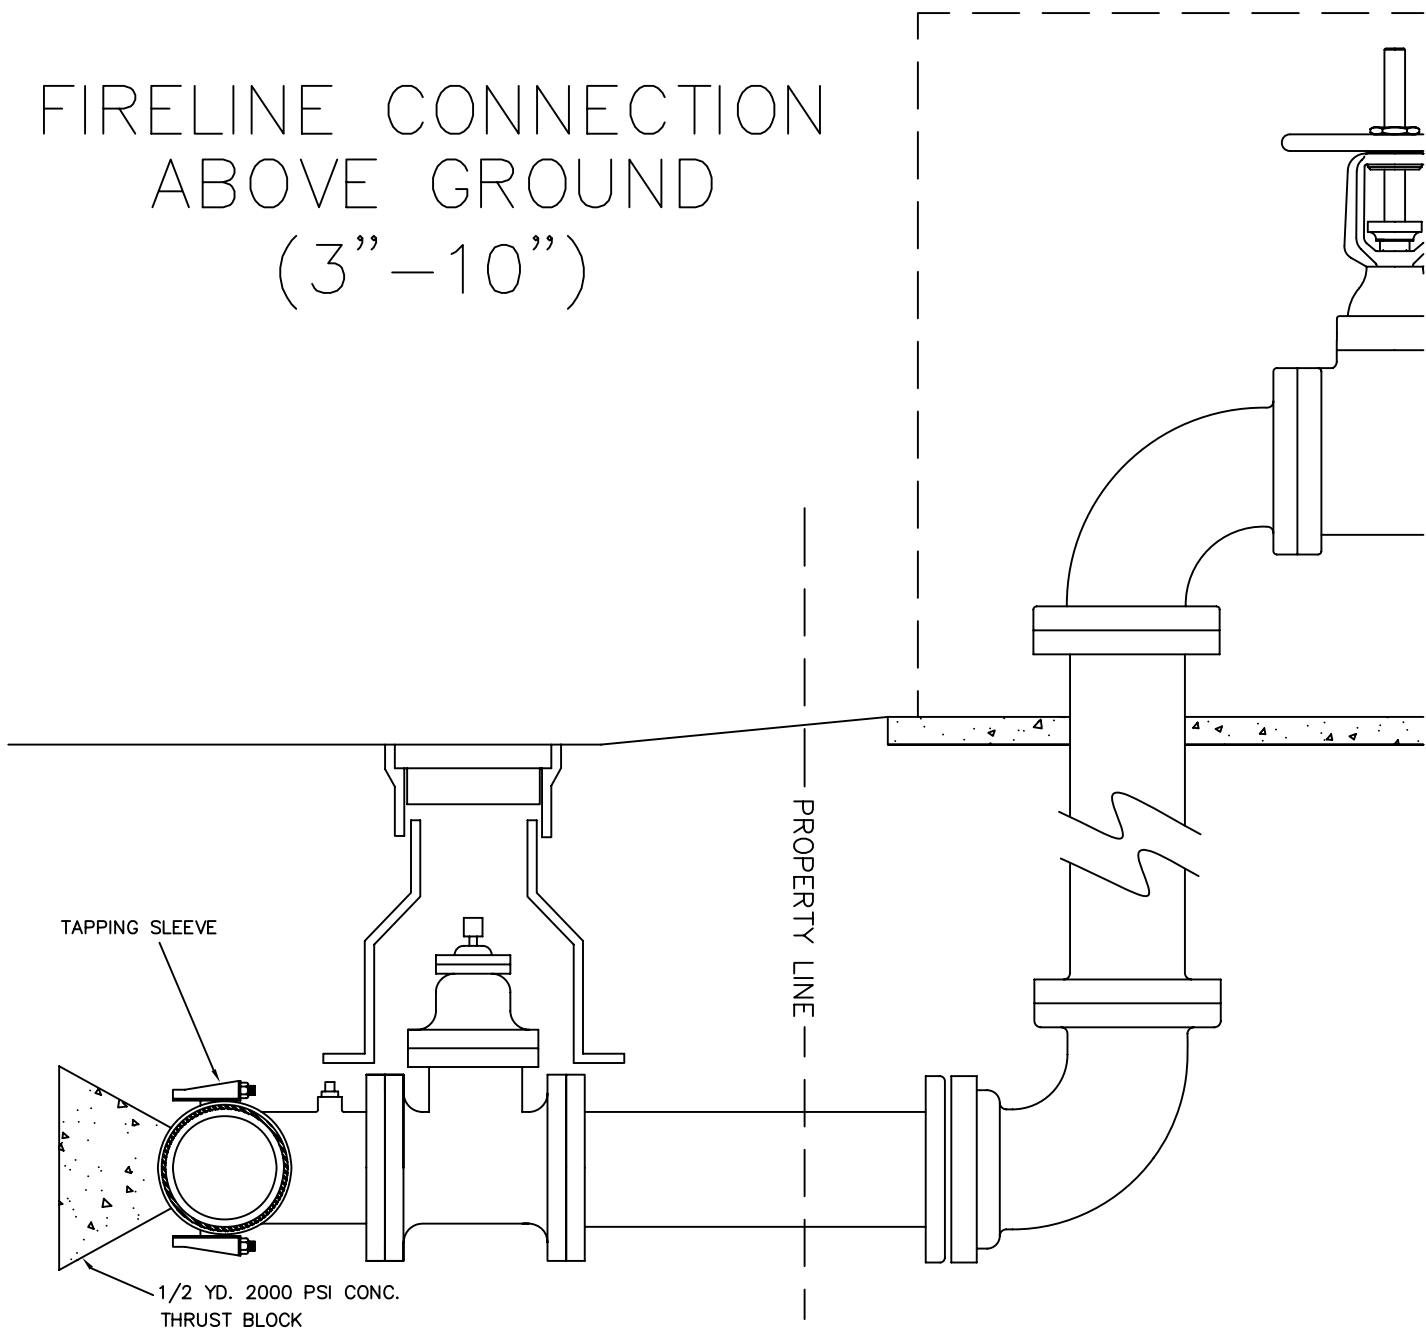

TAPPING SLEEVE

1/2 YD. 2000 PSI CONC.
THRUST BLOCK

PROPERTY LINE

- *RESTRAIN ALL JOINTS.
(I.E. RESTRAINING GLANDS,
FIELD-LOC GASKETS, OR RESTRAINT
JOINT PIPE.)
- * PLANS MUST BE SUBMITTED FOR APPROVAL
- * REFER TO DWI GENERAL MATERIAL SPECS
AND INSTALLATION SPECS.

DAVIDSON WATER INC. WELCOME, NORTH CAROLINA BACKFLOW PREVENTION
BACKFLOW PREVENTION STANDARD DETAIL
FIRELINE CONNECTION ABOVE GROUND (3"–10")
SCALE: NOT TO SCALE REVISED: 10/12/07